NOTES
1. GEOFABRIC BIDIM A14 AND AGGREGATE SOAKAGE UDERPLAY IS REQUIRED FOR PITS WHEN BASE IS MORE THAN 500mm ABOVE AAMGL FOR THE SITE

2. LESS THAN 500mm ABOVE AAMGL PITS TO BE BENCHED

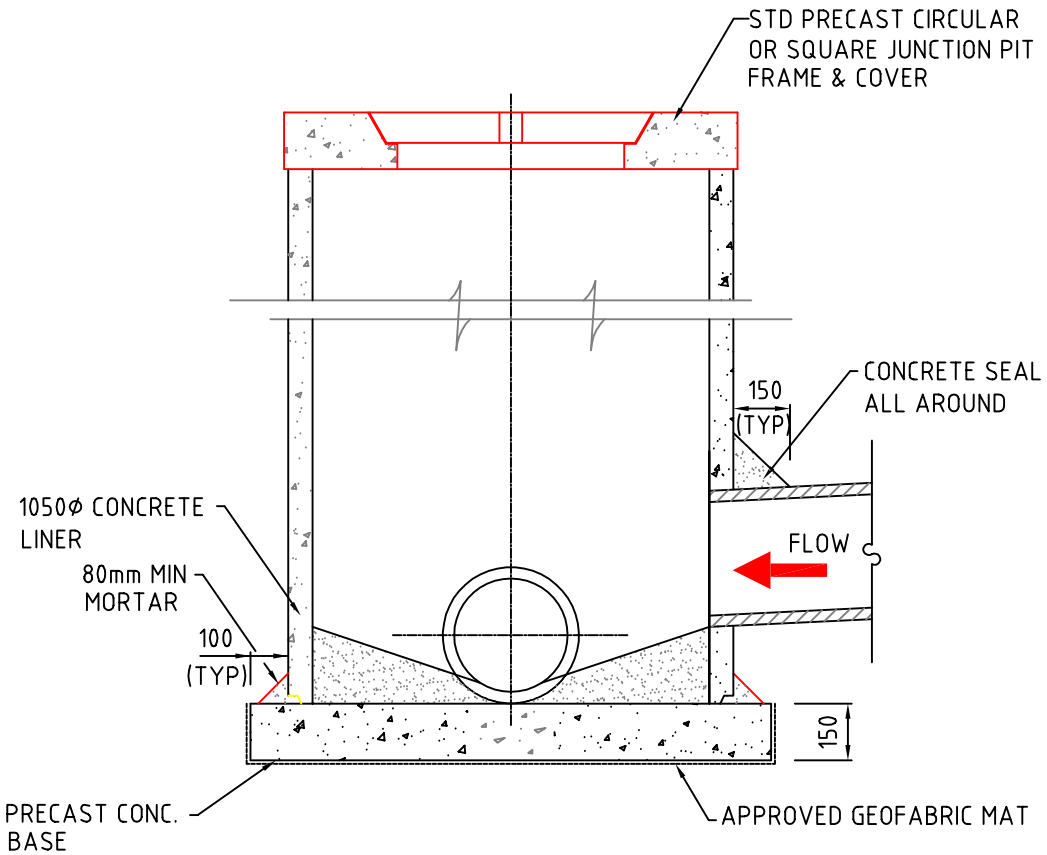

STD LINER JUNCTION PIT
BASE SHOWN FOR WET CONDITIONS

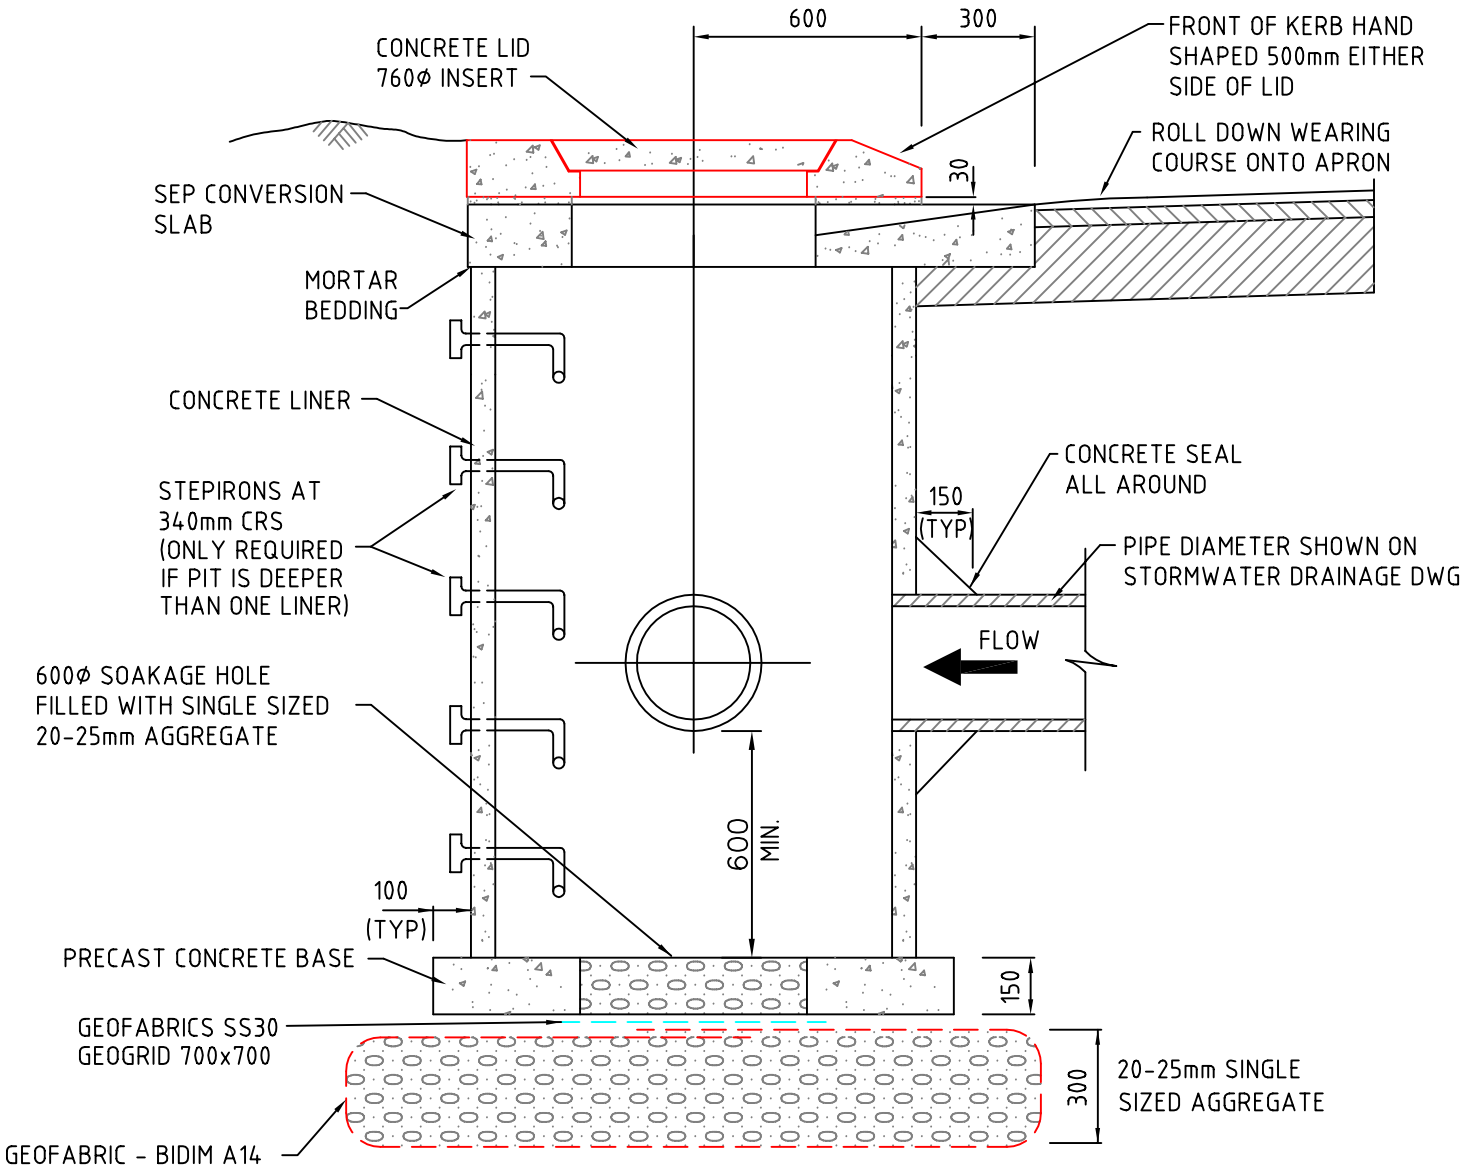

SINGLE SIDE ENTRY PIT WITH SOAKAGE
BASE SHOWN FOR WET CONDITIONS

400 200 0 400 800mm
1:20

No.	Revision-	Chk'd	App'd	Date

CITY OF COCKBURN WOULD LIKE TO ACKNOWLEDGE AND THANK GUTTERIDGEHASKINS & DAVEY PTY. LTD. FOR THEIR ASSISTANCE IN THE PRODUCTION OF THESE STANDARD DETAIL DRAWINGS

CITY OF COCKBURN
9 COLEVILLE CRESCENT, SPEARWOOD WA 6163
PHONE: (08) 9411 3444 FAX: (08) 9411 3416

STANDARD DETAILS

Title
DRAINAGE
SEP SOAKWELL & STD LINEAR JUNCTION PIT

DESIGNED	GHD	APPROVED	
DRAWN	KMF/SYC		
CHECKED	KR	DATE	

SCALE AS SHOWN | JOB No
DWG No 2423B03 | SHEET No 08 | REV