




- NOTES
1. GEOFABRIC BIDIM A14 AND AGGREGATE SOAKAGE UNDERLAY IS REQUIRED FOR PITS WHEN BASE IS MORE THAN 500mm ABOVE AAMGL FOR THE SITE
 2. LESS THAN 500mm ABOVE AAMGL PITS TO BE BENCHED

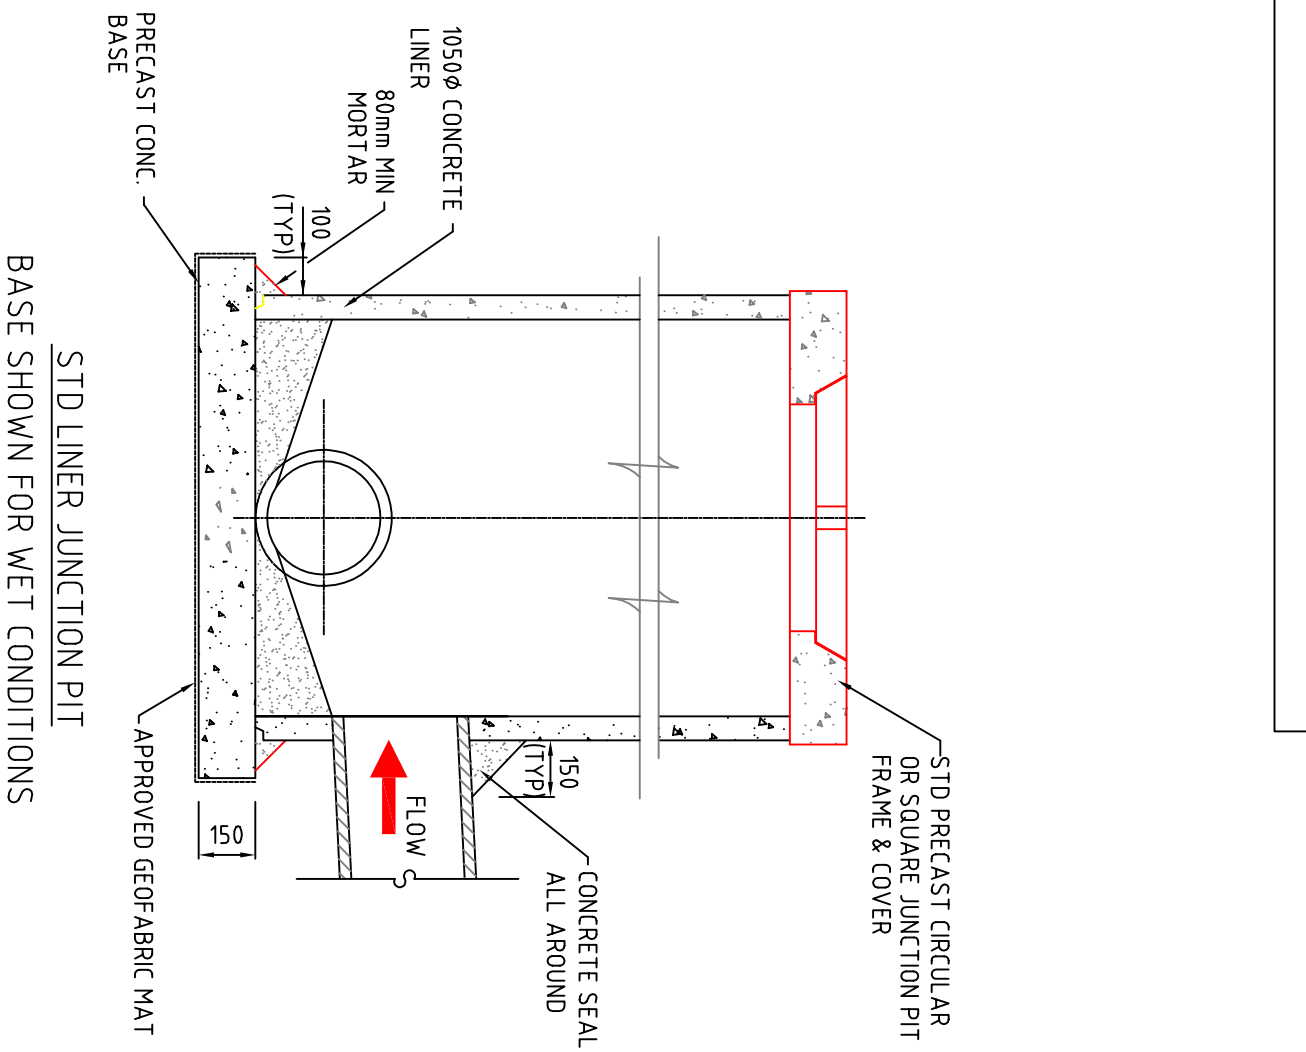

STD LINER JUNCTION PIT
BASE SHOWN FOR WET CONDITIONS

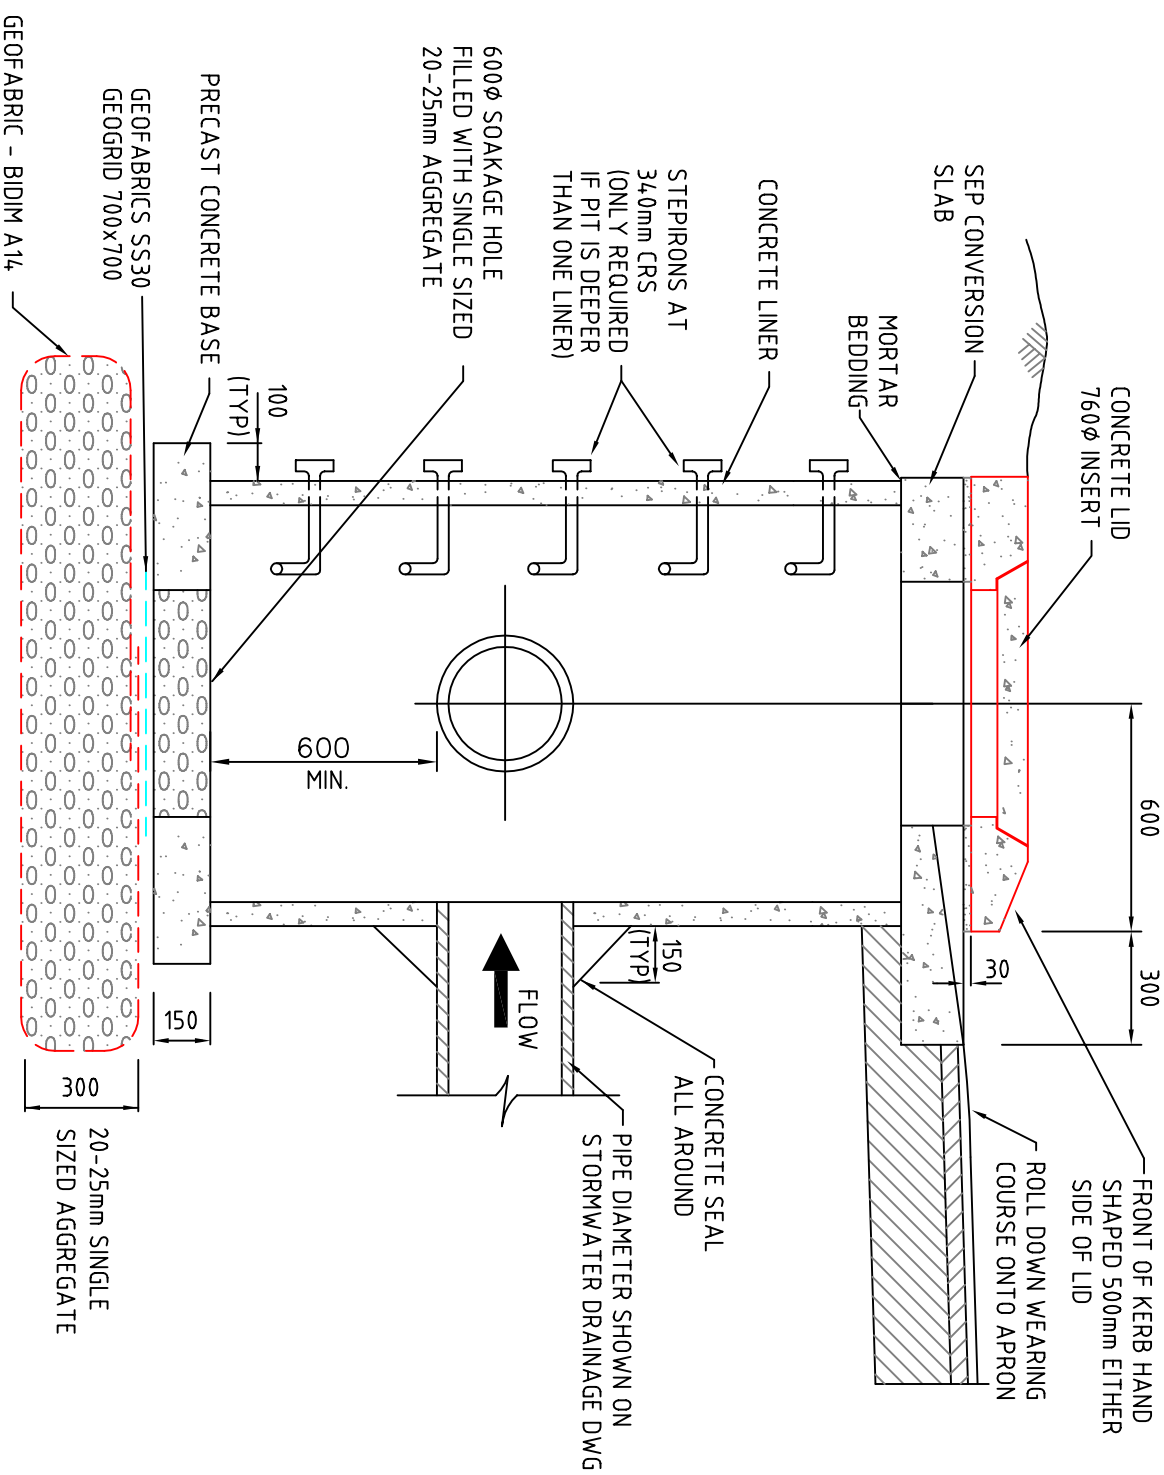

SINGLE SIDE ENTRY PIT WITH SOAKAGE
BASE SHOWN FOR WET CONDITIONS



No.	Revision-	Chk'd	App'd	Date

CITY OF COCKBURN WOULD LIKE TO ACKNOWLEDGE AND THANK GUTTERIDGEHASKINS & DAVEY PTY. LTD. FOR THEIR ASSISTANCE IN THE PRODUCTION OF THESE STANDARD DETAIL DRAWINGS

CITY OF COCKBURN
9 COLEVILLE CRESCENT, SPEARWOOD WA 6163
PHONE: (08) 9411 3444 FAX: (08) 9411 3416

STANDARD DETAILS

Title		DRAINAGE	
SEP SOAKWELL & STD LINEAR JUNCTION PIT		DRAINAGE	
DESIGNED	GHD	APPROVED	AS SHOWN
DRAWN	KMF/SYC	SCALE	DWG No
CHECKED	KR	DATE	2423B03
			SHEET No
			08